




Existing Condition – Box Canyon Road within the Santa Rita Mountains



Simulated Condition – Proposed 138kV corten steel single-circuit transmission line



Simulated Condition – Proposed 138kV galvanized steel single-circuit transmission line

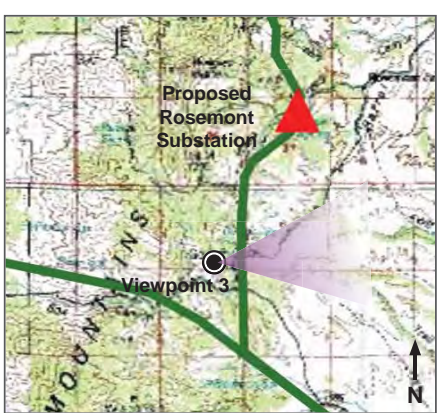

Photograph Location: Box Canyon facing east down Box Canyon Road. Photo point is approximately 0.14 mile from nearest transmission line. Simulation location and viewpoint selected by Coronado National Forest Landscape Architect.

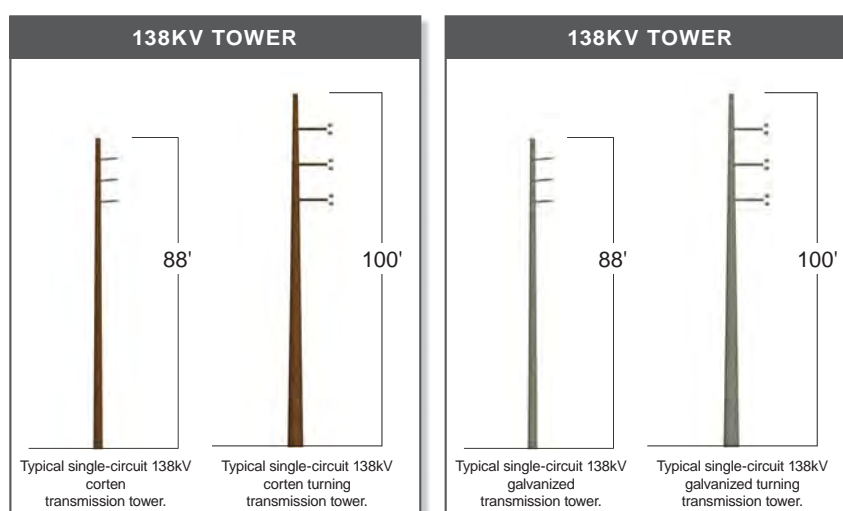


Photo Date and Time: 1-25-10, 12:59 p.m. Focal Length: 50mm

Structure models that were used in the simulations were created using diagrams provided by TEP.

This simulation represents a schematic concept design that will be refined and finalized. Actual final structure sizes, heights, materials, and conductor sag will vary on a case-by-case basis.



**Rosemont Copper Transmission Line Project
Simulation 3 - Preferred Route,
Alternative 1, Alternative 4**

DRAFT

November 16, 2010